

Flexible Analytics for Management of Grid Assets

Jean-Louis Coullon¹ and Navin Rego²

1. Alstom Grid, Immeuble Galilee, Paris La Defense 92907, France

2. Kahramaa, Doha, Qatar

Received: August 20, 2014 / Accepted: November 10, 2014 / Published: April 30, 2015.

Abstract: This paper presents a case study about a condition monitoring project for asset management implementing an advanced decision process for maintenance and asset replacement in the Qatar electricity distribution network. It describes the principles used to produce an assessment of the health of the entire fleet of assets, together with the concepts retained to prioritize the interventions on the distribution network equipment. The paper goes through the actual steps taken for the preparation and execution mode of the overall project. It covers the following project phases: definition of the problem & business objectives, process definition and preparation tasks, presentation of solutions and execution phase. The project being still in the implementation phase, the conclusions are preliminary but already demonstrate concrete and tangible benefits.

Key words: Analytics, assets, condition, criticality, health, maintenance, mobility, reliability, replacement, risk.

1. Introduction: Problem and Business Objectives

This project has been established by Kahramaa (the sole utility responsible for transmission and distribution of power in Qatar) with the main business objective to maintain high level of reliability and enhance personnel & equipment safety. To reach this goal, Kahramaa decided to define and implement a company-wide set of process and tools, capable of supporting decisions and setting priorities for condition-based maintenance and repair actions.

To produce meaningful and effective results, this set of process and tools has to operate on reliable data. For this, it was decided to:

- Carry out a comprehensive condition monitoring program of the Qatar 11 kV distribution network in live condition (in service condition) to get a current & complete condition of the equipment;
- Establish a central system hosting asset identification with all condition data, in order to further capitalize information and centralize decisions;

Corresponding author: Jean-Louis Coullon, asset management director, research fields: energy management, Alstom senior expert. E-mail: jean-louis.coullon@alstom.com.

The overall scope consists in more than 11,000 secondary substations MV/LV (medium voltage/low voltage) to be visited and assessed in three years. These include various types of indoor & outdoor MV switchgear with various isolation techniques (vacuum, oil, sulfur hexafluoride SF₆), oil immersed and dry MV/LV power transformers and LV panels.

As many as 18 switchgear manufacturers, 40 transformer manufacturers, and 17 manufacturers of distribution feeder pillars are used today.

2. Preparation Tasks and Definition of Processes

Kahramaa specification document describes the main business objective, the concerned assets, the measurement techniques and the expected results. From there, the first action was to articulate the process to be followed to implement such a large undertaking. This was split in two main areas:

- The data collection and analysis process, to make sure that the business goals will be met;
- The team mobilization process, to setup quickly the proper organization to cover such a large task.

2.1 Process for Data Collection and Analysis

A number of steps have been taken to define the process to be followed, setup the corresponding tools, the IT systems and their interactions.

2.1.1 Definition of Analytics

The first step is the definition of the expected results and how to get there. The main business objectives are: (1) to define maintenance priorities; (2) to make decisions for replacement when asset condition is such that maintenance or repair actions are not practical or not economical.

This overall objective has been implemented through a strong methodology supported by a number of key analytics, provided by Alstom Grid e-terraassetcare software product. These include:

- the AHI (asset health index), a representation of the residual life, targeted at asset replacement analysis;
- the AMI (asset maintenance index), indication of the distance to the next maintenance action;
- POF (probability of failure), relying on statistical analysis to evaluate the exposure to major failure;
- additional key information, such as ERL (estimated residual life), an estimation of the number of years till practical end of life.

Then a criticality analysis (ACI (asset criticality index)) is attached on each asset to evaluate the consequences of a major failure on the utility business. Combined with the probability of failure, it provides an estimation of the risk incurred by the utility (asset risk index).

Together, these indices constitute the set of key analytics retained to assess the situation of the distribution assets and support the decision process.

Finally, a process for monitoring information, managing alerts, and defining remedial measures is implemented to take and manage the corrective actions.

2.1.2 Measurement Techniques

All the above analytics cannot provide any meaningful results without solid data on assets. As per Kahramaa innovative and visionary requirements, comprehensive and consistent sets of non-intrusive

measurements were required to be taken for all assets when visiting the substations. These are grouped in the main categories below:

- Visual inspections: the visits include a systematic review of all key control points, such as oil leakages, gas pressures, status of gauges, environment status, corrosion, civil condition, abnormal noise;
- Thermal analysis: via temperature measurements, but also Infra-Red analysis, the field inspection teams collect a thermal image of the assets. This is used to detect any anomalous behavior or hotspots that could generate damage to the equipment, or are the sign of a degradation of the asset itself;
- Partial discharge: evaluation of the level of PD (partial discharge) around each piece of MV equipment helps detecting abnormal situations, locating anomalies and defining corrective actions;
- Oil analysis for oil immersed Transformers is done in a systematic manner, providing DGA (dissolved gas analysis) analysis, oil quality, and also analysis of Furans to help in the overall evaluation of the ageing of the asset.

2.1.3 Definition of Health Models

Multiple sources of expertise have been involved to build the health model adapted for each asset type. Combining existing models, manufacturing and service expertise from the supplier, with Kahramaa experience and recommendations from standards such as CIGRE (Conference Internationale des Grands Réseaux Electriques) A2.34 WG (working group) for Transformer maintenance, IEEE (Institute of Electrical and Electronics Engineers) C57.104 and IEC (International Electrotechnical Commission) 60599 for DGA analysis, CIGRE TB (Technical Brochure) 227 for transformer condition, was essential to establish robust and trustable health models adapted to the actual utility context.

A total of 12 different asset types have been created to represent the various assets in the grid, sized for approximately 150,000 assets, each asset type having its own Health Model, made of an average of about 50

condition parameters.

A quantified scoring system is used to represent the asset health. The condition parameters are scored as per the actual site conditions and evaluation of data analyst. The scores are then co-related with the weighting factor of the respective condition parameter. The weighting factor of the condition parameter is decided based on various factors such as, the relative degree of importance of that parameter in determining the health of the asset, utility experience.

2.1.4 Tools for Data Management

For such a large number of assets and data elements to be created, a strong data management has been put in place. This starts with a proper definitions of data, grouped in key documents such as the data dictionary and the glossary of terms, essential to allow people from different business domains to communicate toward one single objective.

A second element key for success was the strict definition of the data management flow, from the field to the final reports, broken down in smaller, manageable functional units connected via proper interfaces, and allowing the creation of independent tasks executed in parallel. This is presented in Fig. 1.

2.2 Team Mobilization

The goal was to mobilize rapidly the proper set of experts in the various measurement techniques, define common tooling & methods, get the teams certified for technical expertise and compliance to safety regulation requirements. Fig. 2 is an example of the precautions taken when measuring on live equipment.

This strict process has been fully defined upfront and actually verified by site audits.

3. Solutions

For this project, the supplier has mobilized expertise and resources coming from multiple parts of the organization, including:

- the service business line;
- the network management business line;

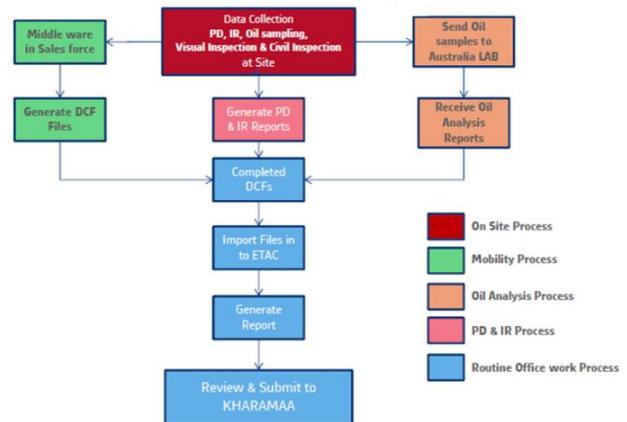


Fig. 1 A simple view of the data management flow, defined for an effective delivery mechanism of the reports to Kahramaa.



Fig. 2 PD measurement on switchgear with anti-arc flashing clothing.

- the equipment manufacturing business line;
- the asset management activity.

All these skills are working together to fully cover the business objectives, as highlighted in Ref. [1].

In addition to these skills and set of processes, this project is supported by two key products:

- the e-terraassetcare software product for the AHM (asset health management) function;
- the Alstom Grid field mobility suite, ranging from tablet-based applications for data entry on site, up to automatic integration into the health model of the AHM.

3.1 The AHM Function

The objective of the AHM function is to effectively support advanced strategies in the field of asset maintenance, asset replacement, and risk-aware grid operation. These strategies can move from time-based,

to usage-based, to condition-based and to reliability-based by considering the condition and criticality of each piece of equipment.

AHM provides interfaces to consolidate all asset related data, coming from manual records, inspection reports, on-line condition monitoring devices and also usage data from real-time systems such as SCADA systems (supervisor control and data acquisition). Assets are then analyzed through flexible health models, which encompass equipment design, manufacturing and service knowledge along relevant CIGRE/IEC/IEEE standards. These models are fully adaptable to integrate utility specific conditions and internal expertise.

All these data are combined to produce advanced, synthetic indices such as the AHI representing the effective age of each piece of equipment. An example of this set of data for power transformers is described in Ref. [2].

In the subsequent step, the criticality index of each piece of equipment is added to combine the health information with the business impact of a potential failure of this piece of equipment, resulting in an evaluation of the actual risk exposure. This overall process is further described in Ref. [3].

Presented in comprehensive dashboards such as the one in Fig. 3, this information can be used to issue alerts for maintenance actions and eventually trigger work orders in the CMMS (computerized maintenance management system) of the utility.

In short, AHM helps utilities to define optimum maintenance schedule and asset replacement plan. No longer based on time & budget constraints only, these plans will take into account the actual condition and criticality of each piece of equipment, thus optimizing overall expenses with a risk-aware view of the situation.

The high level vision implemented by this product was introduced in book “Smart Grids” [4], where the section on asset management has been produced by the author of this paper.

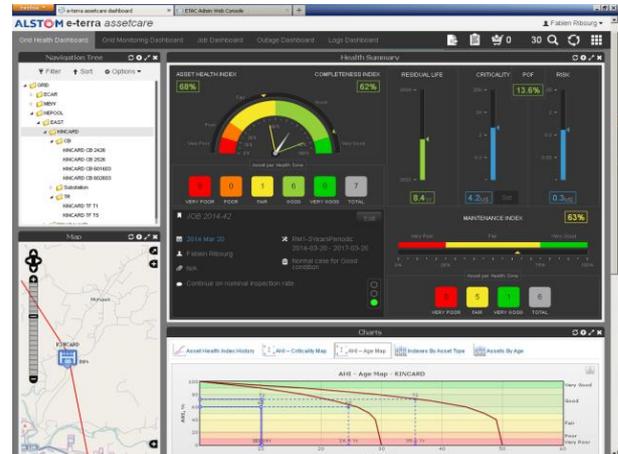


Fig. 3 A typical asset health dashboard, with the asset navigation tree, geo-referenced displays, analytics presented in synthetic charts for effective decision support.

3.2 The Field Mobility Suite

Thanks to the progress of mobile platforms, it is now possible to consolidate the field experience in servicing power equipment with the methodologies defined by experts into a suite of applications running on tablets and integrated with the overall utility information architecture as shown in Fig. 4.

On one single mobile platform can run an integrated set of features, ranging from work orders management, collection of field data including pictures, safety processes, documentation management, up to time sheets for cost tracking.

Many benefits are obtained from this new, integrated set of tools:

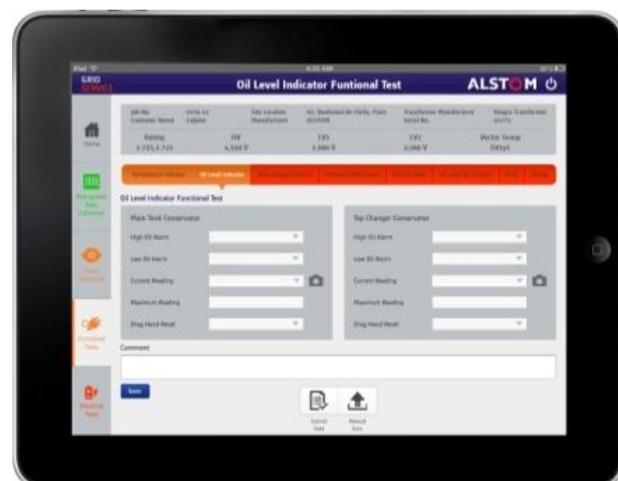


Fig. 4 Tablet applications are used for capturing field data on equipment condition, together with updating static data on the equipment model whenever needed.

- Standardization of practices: all field personnel implement the same practices and consistent methodology, making measurements reliable and repeatable;
- Data collection is streamlined, made systematic, checked immediately and sent automatically to the enterprise level for immediate action. As an examples, site pictures can easily be captured and integrated in the information structure;
- Help for users: documentation is readily available, synchronized with the actual task being performed;
- Cost & time reduction: fastest reaction times, reduced errors, well defined & integrated processes, all this result in significant reduction of site costs, and time saving for scarce power equipment experts.

4. Execution Phase

Given that the project is still in execution, only partial results are available at this time. However, benefits are already visible as shown below.

4.1 Team Mobilisation

Addressing such a large scope in this time constraint was a real challenge. Actually, the multiple inspection teams have been mobilized with a small variance only against the schedule, not impacting the results or the overall timeline.

Mobilisation has reached the targeted inspection rate and even exceeded the plan in some cases as shown in Fig. 5, thanks to the tablet-based mobility tools and a strict project management process.

4.2 Results

In addition to a timely execution, quality is a key focus, so that information and then decision can be built on reliable data. First results are quite positive in this regards.

Quality audits are run periodically as shown in Fig. 6.

Upon inspection, data collection files are loaded into the AHM software, where analytics are computed, completed by analyst diagnostics and decisions, and

then exported to build the management reports.

Reporting consists in fleet analysis charts, comments, and anomaly reports summarizing the abnormal situations detected together with the recommended corrective actions. A few examples of these charts are presented in Figs. 7-9.

4.3 Outcome-Decision Support

Finally, the management report provides a summary of all recommended actions, with an urgency level, leading in some cases to assets replacements. Fig. 10 is

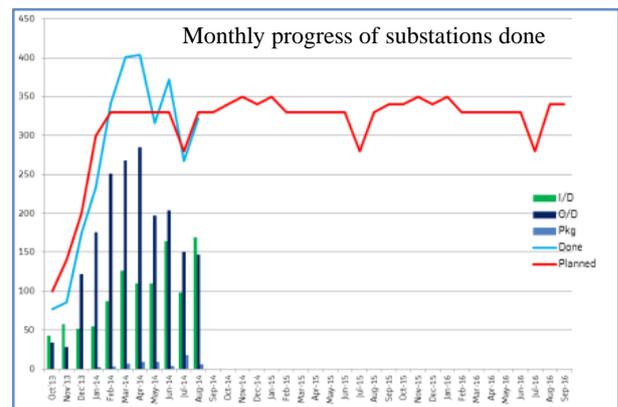


Fig. 5 Thanks to the tablet-based mobility suite, the substation inspection rate (blue curve) is above the planned rate (red curve).



Fig. 6 The quality of the execution is demonstrated by the quality audits and certificates issued by Kahramaa.



Fig. 7 An overall summary for a part of the grid, showing the number of assets by health zones, immediately highlighting the assets of concern.

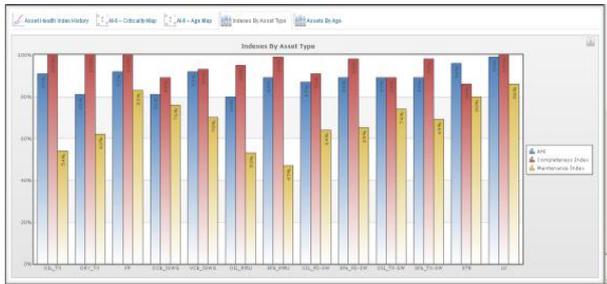


Fig. 8 The summary of key indices per asset type provides a quick comparison and sanity check.

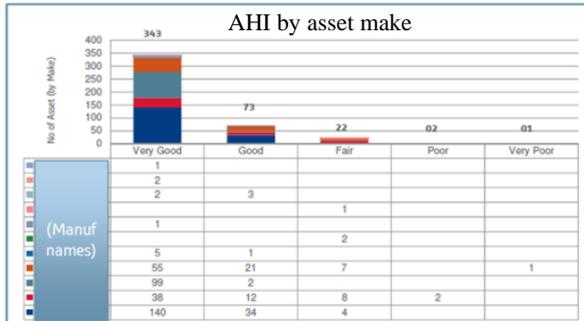


Fig. 9 for one asset type, health index per Make for one given inspection period focuses on potential issue (manufacturer names are hidden).

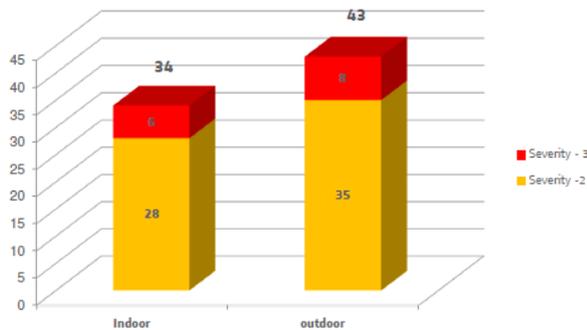


Fig. 10 Required interventions, by urgency level.

a graphical representation of the urgent recommended interventions.

Only a few months after the project initialization, all these actions have translated in well identified avoided failures in the grid, demonstrating the concrete benefits for Kahramaa.

5. Conclusions

As evidenced by the recent issuance of ISO (International Standards Organization) 55000 standards,

asset management is the next area for efficiency improvement at asset-intensive industries like electrical utilities.

Products are now available, so that implementation risks are minimal for utilities.

First findings such as the ones obtained from the innovative project introduced in this paper demonstrate that benefits can be rapidly recognized in the definition of maintenance priorities and decisions for asset replacement.

However, this requires a well-structured approach and methodology, to avoid being lost in the big data syndrome, and lose the business perspective. The key ingredients to be required from solutions suppliers are:

- experience and detailed knowledge in power equipment design and service;
- flexible models to cope with various equipment types and situations;
- well-designed business processes;
- actual products, in order to reduce the time and development risks;
- cooperation and teamwork with skills ranging from electrical knowledge, data management, deployment & integration of information systems, utility processes, grid operation and maintenance experience.

References

[1] Nouredine, H., and Jean-Claude, S. 2012. *Smart Grids*. Hoboken: Wiley, 99-102. Accessed August 20, 2014. <http://eu.wiley.com/WileyCDA/WileyTitle/productCd-1848212615.html>.

[2] Jean-Michel, A. 2014. "Condition Parameters Included in Health Index." Contribution to Study Committee A2, CIGRE 2014, Paris, France.

[3] Jean-Louis, C. 2014. "Analytics for Effective Asset Management." Contribution to Study Committee A2, CIGRE 2014, Paris, France.

[4] Paul, G. 2013, "Optimized Asset Management." *Transmission and Distribution*. 3 (June/July): 1-5. Accessed August 20, 2014. <http://www.powertrans.com.au>.